


Permit Reference Number : EPR / TP3836CT

Operator : Viridor

Installation: Beddington

Form Number: AIR 4 / 23/07/13 [A2]

Reporting of Continuously Monitored Emissions to Air for CO mg/m3 at Emission Point A2 For the month of October 2020

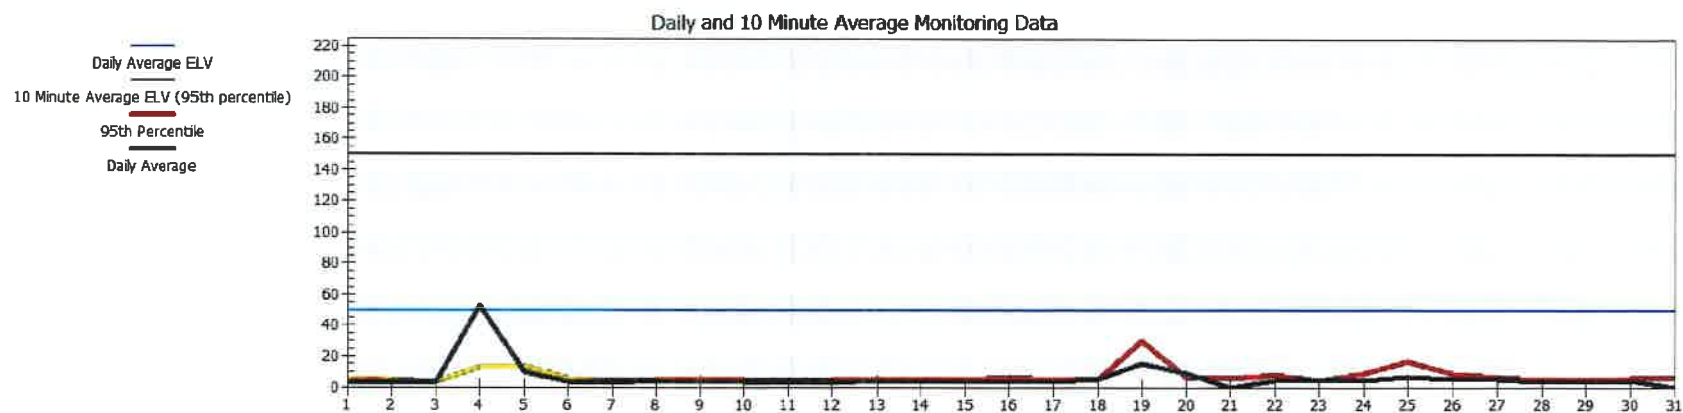

Monthly summary			Date	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	25	26	27	28	29	30	31
10 Minute average			10 Minute average ELV (95th Percentile)	150	150	150	150	150	150	150	150	150	150	150	150	150	150	150	150	150	150	150	150	150	150	150	150	150	150	150	150	150	150	150
	Monthly Maximum	4161	Maximum 10 Minute average	9	16	64	1161	601	13	6	53	10	6	21	8	75	10	21	17	10	360	614	542	20	27	131	57	310	178	150	29	23	13	461
	Monthly 95th Percentile	30	95th Percentile	5	5	4	13	13	6	4	5	6	5	4	5	6	5	5	6	5	5	30	7	6	8	5	9	17	9	7	5	5	6	6
	Monthly minimum	0	Minimum 10 Minute average	2	1	1	0	0	0	2	1	2	2	0	1	2	1	2	0	1	1	0	0	0	0	2	2	2	0	1	2	2	2	0
	Total Invalid results	42	No of Invalid results	1	1	1	1	2	1	1	1	2	2	2	2	2	1	2	2	1	2	2	2	1	1	2	1	2	1	1	0	1	1	0
			Number of results above 150mg/m³	0	0	0	4	1	0	0	0	0	0	0	0	0	0	0	0	0	1	4	2	0	0	0	0	1	1	1	0	0	0	2
	Sum of Exceedances of 95th percentile ELV	0	95th Percentile Exceeds ELV	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N
Daily average			Daily average ELV	50	50	50	50	50	50	50	50	50	50	50	50	50	50	50	50	50	50	50	50	50	50	50	50	50	50	50	50	50	50	50
	Monthly maximum	53	Daily average	4	3	3	53	10	4	3	4	4	4	3	3	4	3	4	4	3	5	15	9	N/A	4	4	4	7	5	5	4	4	4	N/A
	No of invalid days	0	Value Valid?	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	
	Sum of exceedances	1	Value Exceeds ELV?	N	N	N	Y	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N

Signed.....
(Authorised to sign as a representative of the Operator)

Date..... 04.11.2020