

Permit Reference Number : EPR / TP3836CT


Operator : Viridor

Installation: Beddington

Form Number: AIR 2 / 23/07/13 [A1]

Reporting of Continuously Monitored Emissions to Air for VOC mg/m³ at Emission Point A1 For the month of June 2022

Daily and Half-hourly Average Monitoring Data

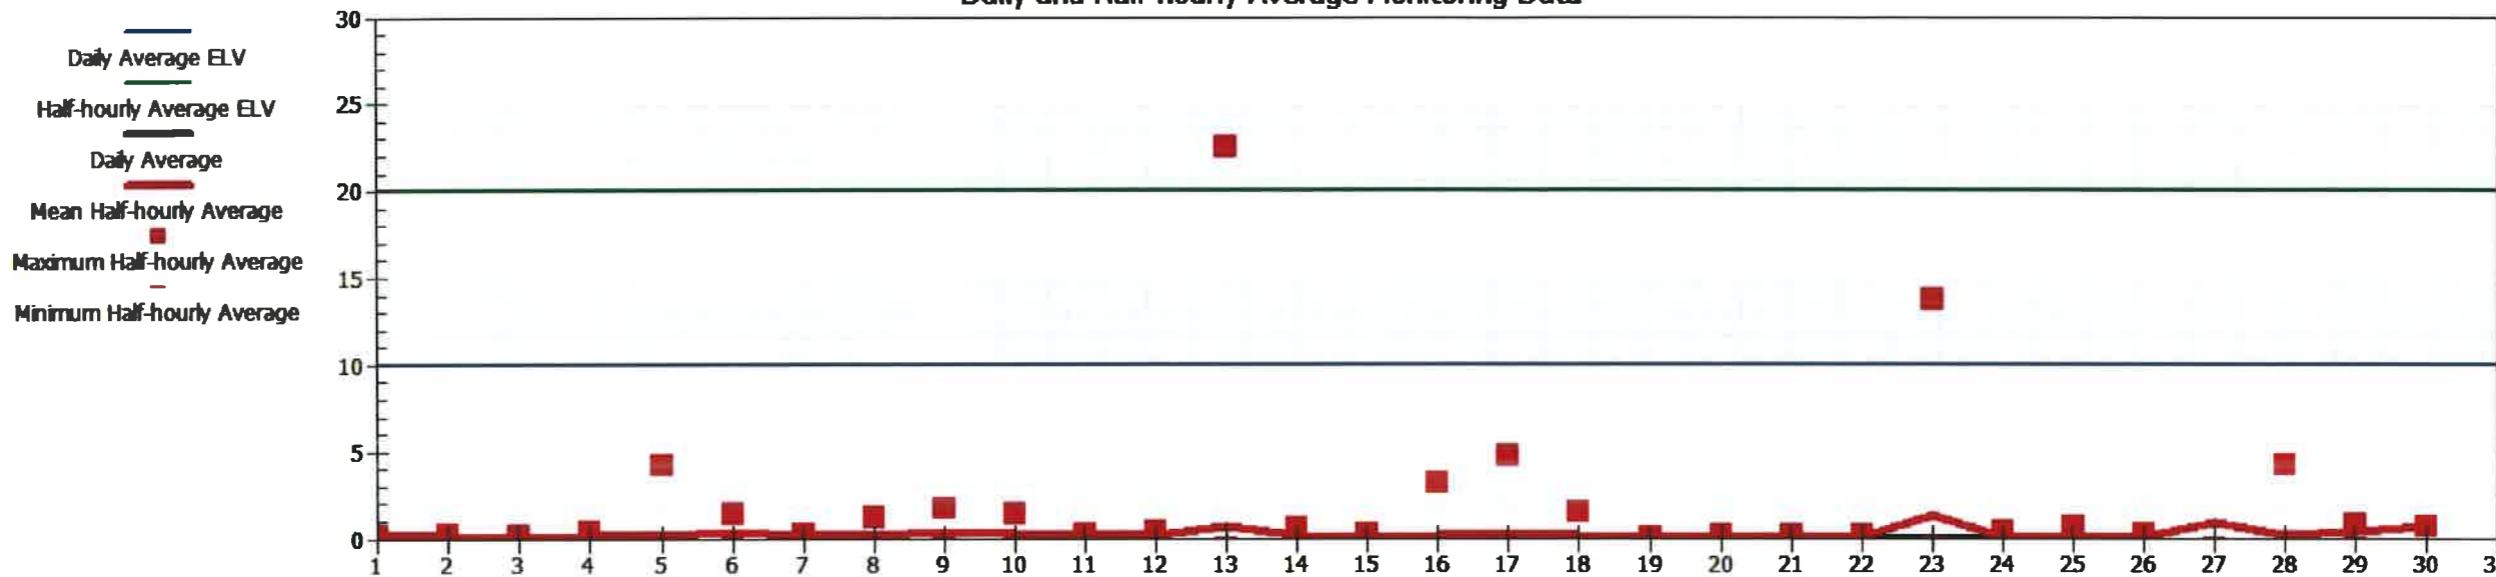

	Monthly summary		Date	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	25	26	27	28	29	30	31
Half-hourly average			Half-hourly average ELV	20.0	20.0	20.0	20.0	20.0	20.0	20.0	20.0	20.0	20.0	20.0	20.0	20.0	20.0	20.0	20.0	20.0	20.0	20.0	20.0	20.0	20.0	20.0	20.0	20.0	20.0	20.0	20.0	20.0		
	Monthly maximum	35.2	Maximum Half-hourly average	0.2	0.2	0.1	0.4	4.2	1.4	0.2	1.2	1.7	1.4	0.3	0.4	22.5	0.6	0.3	3.2	4.8	1.6	0.1	0.2	0.2	0.2	13.7	0.4	0.7	0.3	35.2	4.2	0.8	0.7	
	Monthly mean	0.3	Mean Half-hourly average	0.1	0.1	0.1	0.1	0.2	0.3	0.1	0.1	0.3	0.2	0.1	0.1	0.6	0.1	0.1	0.2	0.2	0.1	0.1	0.1	0.1	1.3	0.1	0.1	0.1	0.9	0.2	0.4	0.7		
	Monthly minimum	0.0	Minimum Half-hourly average	0.1	0.1	0.0	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	
	Total Invalid results	0	No of Invalid results	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0		
	Sum of exceedances	2	No of exceedances of ELV	0	0	0	0	0	0	0	0	0	0	0	0	0	1	0	0	0	0	0	0	0	0	0	0	0	0	1	0	0	0	
Daily average			Daily average ELV	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0		
	Monthly maximum	0.9	Daily average	0.1	0.1	0.1	0.1	0.2	0.3	0.1	0.1	0.3	0.2	N/A	0.1	0.6	0.1	0.1	0.2	0.2	0.1	0.1	0.1	0.1	0.1	N/A	0.1	0.1	0.1	0.9	0.2	0.4	0.7	
	No of invalid days	0	Value Valid?	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y		
	Sum of exceedances	0	Value Exceeds ELV?	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N		

Signed.....

Date..14.07.22

(Authorised to sign as a representative of the Operator)