


Permit Reference Number : EPR / TP3836CT

Operator : Viridor

Installation: Beddington

Form Number: AIR 4 / 23/07/13 [A1]

Reporting of Continuously Monitored Emissions to Air for CO mg/m3 at Emission Point A1 For the month of May 2022

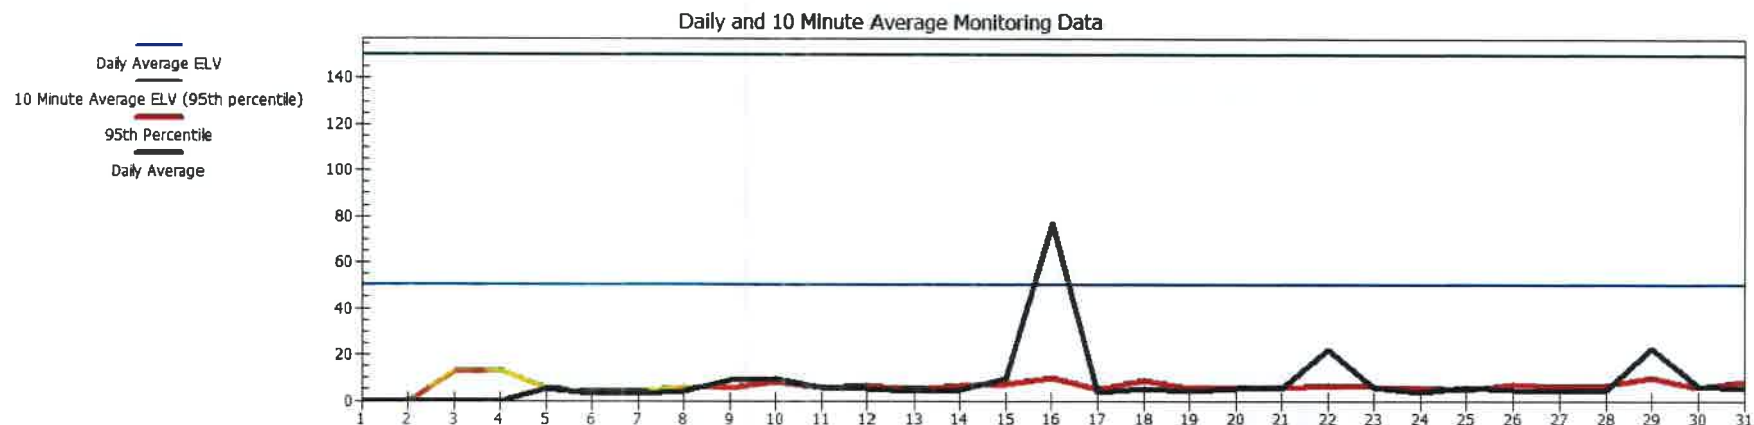

Monthly summary			Date	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	25	26	27	28	29	30	31
10 Minute average			10 Minute average ELV (95th Percentile)	150	150	150	150	150	150	150	150	150	150	150	150	150	150	150	150	150	150	150	150	150	150	150	150	150	150	150	150	150	150	150
	Monthly Maximum	6731	Maximum 10 Minute average	Off	Off	264	64	108	22	7	144	399	558	257	110	8	24	609	6731	6	115	9	168	117	104	163	22	298	29	39	74	2298	182	21
	Monthly 95th Percentile	13	95th Percentile	Off	Off	13	13	6	4	4	7	6	9	6	7	5	7	7	10	5	9	6	6	6	7	6	6	5	7	6	7	10	6	8
	Monthly minimum	0	Minimum 10 Minute average	Off	Off	3	0	2	1	2	1	2	3	2	0	2	2	2	2	2	2	2	1	2	1	2	1	2	2	2	2	2	2	3
	Total Invalid results	26	No of Invalid results	0	0	0	0	0	1	1	1	1	1	1	1	1	1	1	2	0	1	1	1	1	1	1	1	1	1	1	1	1	1	
			Number of results above 150mg/m³	Off	Off	2	0	0	0	0	0	2	1	1	0	0	0	1	3	0	0	0	1	0	4	1	0	1	0	0	0	1	1	0
	Sum of Exceedances of 95th percentile ELV	0	95th Percentile Exceeds ELV	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N
Daily average			Daily average ELV	50	50	50	50	50	50	50	50	50	50	50	50	50	50	50	50	50	50	50	50	50	50	50	50	50	50	50	50	50	50	50
	Monthly maximum	77	Daily average	Off	Off	N/A	N/A	5	3	3	4	9	9	6	5	4	5	9	77	4	5	4	5	5	22	6	4	6	5	4	5	23	6	5
	No of invalid days	0	Value Valid?	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	
	Sum of exceedances	1	Value Exceeds ELV?	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	Y	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N

Signed D. Mderilic
(Authorised to sign as a representative of the Operator)

Date 4.06.2022