


Permit Reference Number : EPR / TP3836CT

Operator : Viridor

Installation: Beddington

Form Number: AIR 4 / 23/07/13 [A2]

Reporting of Continuously Monitored Emissions to Air for CO mg/m³ at Emission Point A2 For the month of May 2022

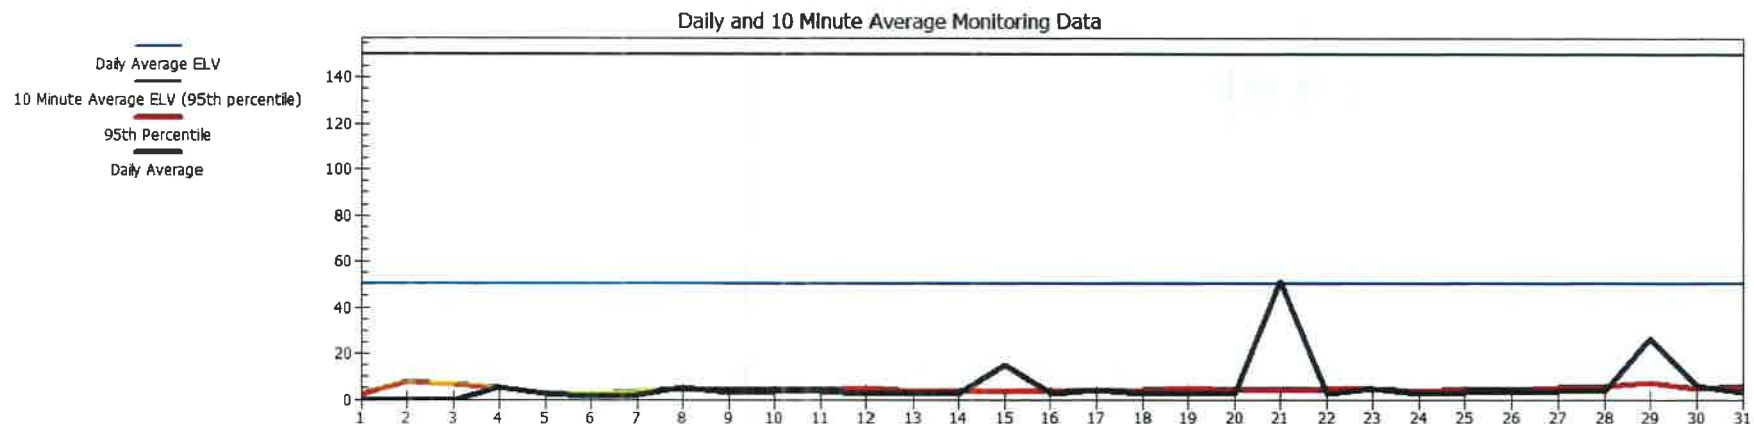

Monthly summary			Date	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	25	26	27	28	29	30	31	
10 Minute average			10 Minute average ELV (95th Percentile)	150	150	150	150	150	150	150	150	150	150	150	150	150	150	150	150	150	150	150	150	150	150	150	150	150	150	150	150	150	150	150	
	Monthly Maximum	6491	Maximum 10 Minute average	9	26	50	272	113	5	44	447	8	22	68	13	10	11	1500	16	229	6	62	27	349	6	146	11	9	43	7	47	319	377	46	
	Monthly 95th Percentile	8	95th Percentile	3	8	7	5	3	3	3	4	4	5	4	5	4	4	4	4	4	4	5	4	4	5	5	4	4	4	5	6	7	5	6	
	Monthly minimum	0	Minimum 10 Minute average	1	0	2	1	0	1	0	0	2	1	1	1	1	1	1	1	0	1	0	1	0	0	1	1	1	1	1	0	1	0	1	
	Total Invalid results	31	No of Invalid results	0	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	2	1	1	1	1	
			Number of results above 150mg/m³	0	0	0	1	0	0	0	1	0	0	0	0	0	0	2	0	1	0	0	0	2	0	0	0	0	0	0	0	0	1	1	0
	Sum of Exceedances of 95th percentile ELV	0	95th Percentile Exceeds ELV	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N
Daily average			Daily average ELV	50	50	50	50	50	50	50	50	50	50	50	50	50	50	50	50	50	50	50	50	50	50	50	50	50	50	50	50	50	50	50	
	Monthly maximum	51	Daily average	N/A	N/A	N/A	5	2	2	2	5	3	3	3	3	3	2	15	2	4	3	3	2	51	2	5	2	3	3	4	4	27	6	3	
	No of invalid days	0	Value Valid?	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	
	Sum of exceedances	1	Value Exceeds ELV?	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	Y	N	N	N	N	N	N	N	N	N	N	N

Signed P. Androsilic
(Authorised to sign as a representative of the Operator)

Date 1.06.2022