


Permit Reference Number : EPR / TP3836CT

Operator : Viridor

Installation: Beddington

Form Number: AIR 5 / 23/07/13 [A1]

Reporting of Continuously Monitored Emissions to Air for SO₂ mg/m³ at Emission Point A1 For the month of December 2023

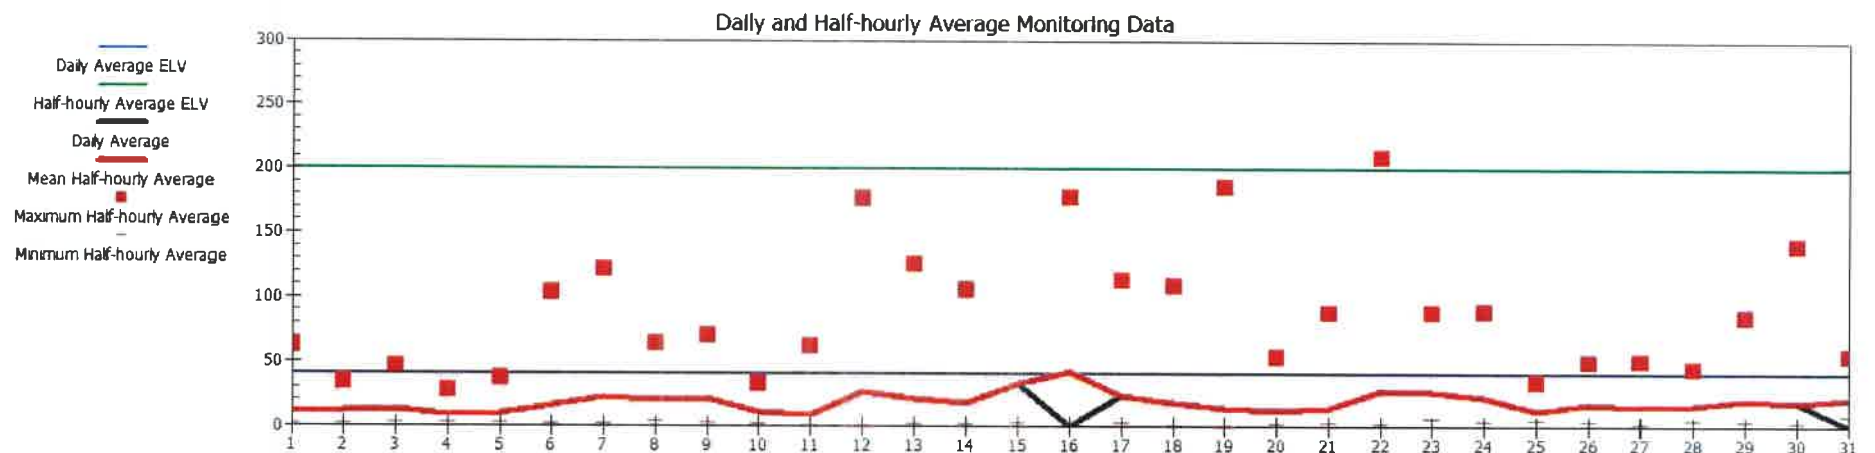

	Monthly summary		Date	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	25	26	27	28	29	30	31
Half-hourly average			Half-hourly average ELV	200.0	200.0	200.0	200.0	200.0	200.0	200.0	200.0	200.0	200.0	200.0	200.0	200.0	200.0	200.0	200.0	200.0	200.0	200.0	200.0	200.0	200.0	200.0	200.0	200.0	200.0	200.0	200.0	200.0	200.0	200.0
	Monthly maximum	356.9	Maximum Half-hourly average	62.6	33.8	46.2	27.3	36.9	103.9	21.8	54.0	71.0	33.1	82.0	177.5	26.1	106.3	356.9	178.7	113.2	109.4	186.3	153.8	88.7	210.0	88.7	89.2	33.8	49.8	50.7	44.4	85.0	140.5	54.7
	Monthly mean	18.6	Mean Half-hourly average	10.5	11.8	12.6	8.8	10.1	16.6	22.5	19.9	21.6	11.3	9.0	27.1	21.2	18.8	32.6	42.1	23.4	18.2	14.6	11.6	14.6	27.6	26.4	22.6	11.9	16.7	15.4	15.8	20.6	18.5	21.2
	Monthly minimum	0.3	Minimum Half-hourly average	1.5	1.7	3.0	3.0	2.5	1.9	1.8	4.0	2.5	1.3	0.3	0.8	1.3	1.9	2.8	2.2	3.1	1.0	1.0	1.9	2.3	1.8	5.6	3.7	4.2	3.2	2.1	5.1	3.5	3.0	7.8
	Total Invalid results	0	No of Invalid results	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
	Sum of exceedances	3	No of exceedances of ELV	0	0	0	0	0	0	0	0	0	0	0	0	0	0	2	0	0	0	0	0	0	0	1	0	0	0	0	0	0	0	0
Daily average			Daily average ELV	40.0	40.0	40.0	40.0	40.0	40.0	40.0	40.0	40.0	40.0	40.0	40.0	40.0	40.0	40.0	40.0	40.0	40.0	40.0	40.0	40.0	40.0	40.0	40.0	40.0	40.0	40.0	40.0	40.0	40.0	40.0
	Monthly maximum	32.6	Daily average	10.5	11.8	12.6	8.8	10.1	16.6	22.5	19.9	21.6	11.3	9.0	27.1	21.2	18.8	32.6	N/A	23.4	18.2	14.6	11.6	14.6	27.6	26.4	22.6	11.9	16.7	15.4	15.8	20.6	18.5	N/A
	No of invalid days	0	Value Valid?	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	
	Sum of exceedances	0	Value Exceeds ELV?	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N

Signed.....*D. Andesilic*.....

Date.....*20.12.2024*.....

(Authorised to sign as a representative of the Operator)